



LEVEL ONE EARTHWORKS REPORT

Proposed Residential Development Elevate Stage 2B Ormeau Hills

OCTOBER 11 2024

Winslow

Authored by: QUALTEST LABORATORY PTY LTD

REF: 7013

Ref: 7013
Job: 24-294a
Author: R. Mitchell

14th October 2024

Winslow
Building 4, G1,
107 Miles Platting Road,
Eight Mile Plains, Qld, 4113

ATTENTION: **MR JOSH BARKER**
Email: joshb@winslow.com.au

Dear Sir,

RE: **LEVEL ONE EARTHWORKS REPORT**

PROJECT: **PROPOSED RESIDENTIAL DEVELOPMENT
ELEVATE STAGE 2B
ORMEAU HILLS**

CLIENT: **WINSLOW**

CONSULTANT: **MORTONS URBAN SOLUTIONS**

CONTRACTOR: **WINSLOW**

Revision	Date	Author	Reviewer	Description
0	11.10.2024	R. Mitchell	M. Morrison	For Review / Issue to Client

1.0 INTRODUCTION

1.1 General

This report presents results and documentation for the Level One Inspection and Testing of earthworks filling operations for the Proposed Residential Development at Elevate Stage 2B, Ormeau Hills (The Site).

Qualtest Laboratory Pty Ltd was commissioned by Winslow (The Client) to provide Level 1 Earthworks Inspection and Testing services as defined in Section 8 of AS3798.

Filling operations covered by this report were constructed between 8th July 2024 and 31st July 2024.

The purpose of Level 1 commission and this report is to provide an opinion that the earthworks operations carried out by the Client have been carried out in accordance with AS3798, relevant project specifications and Local Authority requirements as appropriate.

This report has been carried out in general accordance with the following: -

- AS3798-2007 - Guidelines on Earthwork for Commercial and Residential Development
- Mortons Urban Solutions drawings and notes on drawings.
- Gold Coast City Council Specifications

This report does not cover underground services, trench backfill, pavements, retaining walls, filling outside areas shown on Figure 2 or any other works after 31st July 2024.

1.2 Previous Earthworks

Existing fill was present at The Site. The existing fill was constructed by Winslow under Level One Inspections and Testing by Construction Sciences.

For information regarding the existing fill, refer to the below report: -

- Construction Sciences Report "Works Inspection & Testing, Proposed Residential Development, Lot 4, Dalma Street, Ormeau" with filling operations carried out between 17th July 2019 and 1st October 2019, dated 16th October 2019.

The above report have been reviewed by Qualtest Laboratory. The reports are considered to be appropriate for the existing fill, however we cannot warrant work by others.

1.3 The Development

The development comprises of 16 new lots labelled as Lot 1, Lot 65, Lot 86, Lot 87 and Lot 86 to Lot 102 with associated infrastructure and underground services.

Earthworks to be constructed at the site is presented on Mortons Urban Solutions drawings, Earthworks Cut to Fill Plan Sheet 1 of 2, Drawing No. 35701-02B-040, Amendment B and Earthworks Cut to Fill Plan Sheet 2 of 2, Drawing No. 35701-02B-041, Amendment A and are reproduced below as Figure 1 and Figure 2 respectively below.

These plans are considered to be reasonable indication of the actual fill constructed during our involvement with the following exceptions: -

- Lots 86, 87, 93, 94, 95, 96, 97, 98 and 99 all contained less than 100mm of fill. On this basis, testing of these lots was not required.
- This report covers fill placed only on Lots 92, 101 and 102. These lots have been marked on Figure 1 and Figure 2 below.

Figure 1: Earthworks Cut to Fill Plan Sheet 01 of 02


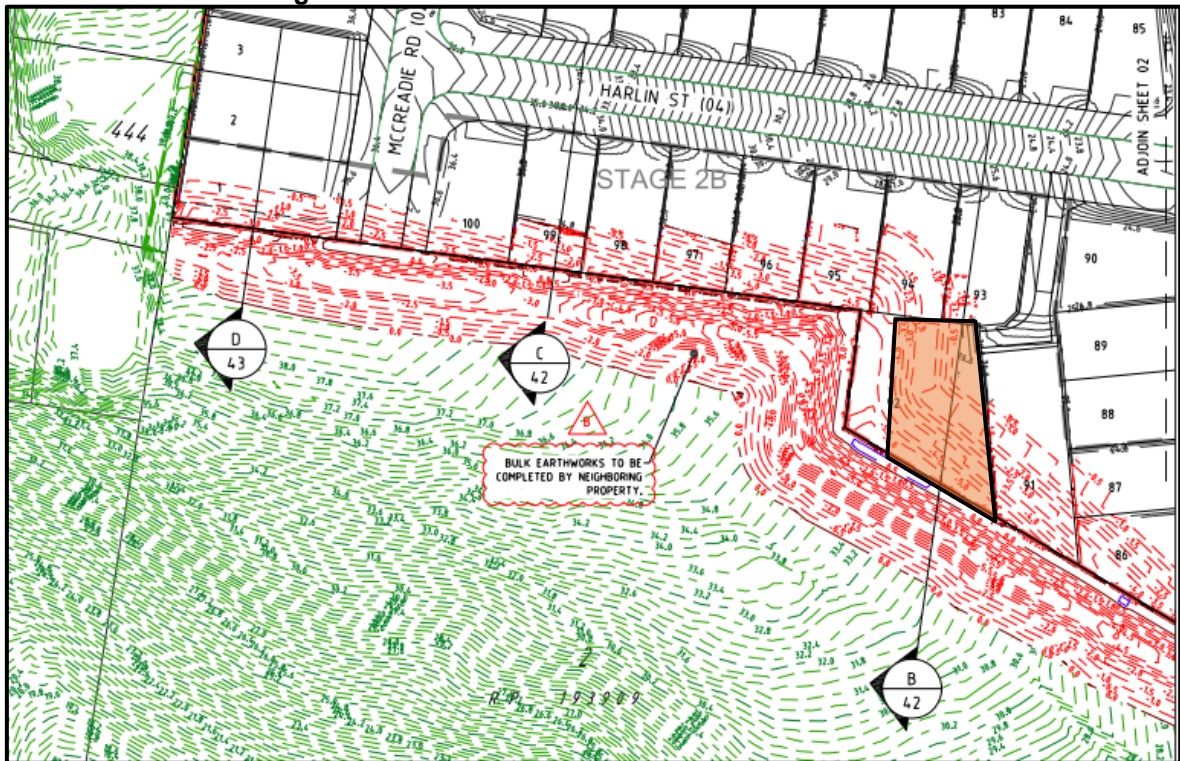


Figure 2: Earthworks Cut to Fill Plan Sheet 02 of 02

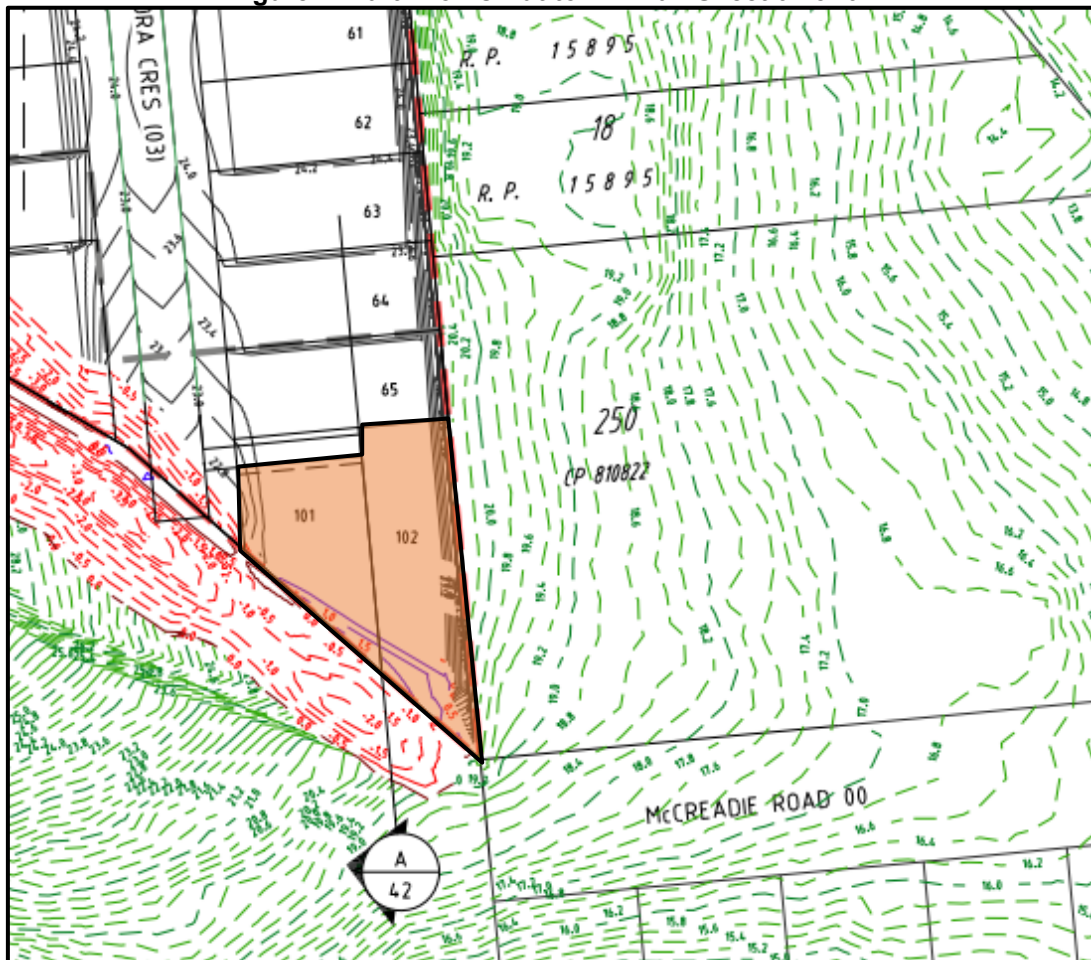

2.0 WORKS AND SPECIFICATIONS

All filling operations at the Site are to be placed and compacted in accordance with the following: -

- AS3798 – Type 1 Earthworks Operations.
- Gold Coast City Council Specifications.
- Density Ratio – 95% Standard.

3.0 FILL FOUNDATION

Areas to be filled at the site were observed to be stripped of existing fill, vegetation, grass, redundant services, water affected ground and topsoil to depths exposing competent natural ground.

Compliance of the fill foundation and approval to commence filling was on the basis of: -

- Adequate removal of topsoil and organics to expose natural soils generally consisting of the following: -
 - Gravelly Sandy Clay (CL), at least stiff, low plasticity, fine to coarse sands and gravels, grey brown and moist.
 - Meta Sandstone (HW), typically medium strength, highly weathered, dark brown.
- Compliant proof roll testing of the stripped surface using onsite earthworks plant.

A picture of the stripped natural surface prior to filling is presented below.

Picture 1: View of Stripped Surface



4.0 FILLING OPERATIONS

Fill at the site was sourced onsite and included: -

- Onsite Cuts, Stockpiles and Trench Spoil.

Materials used as fill can be broadly summarised as: -

- Clayey Gravel (GC), fine to coarse gravels and sands, occasional cobble sized particles, low plasticity fines, brown, grey brown and moist.

Fill was constructed using the following plant: -

- Water Truck
- Padfoot Roller
- Excavator
- Body Trucks

Fill was observed to be placed in layers within the capacity of the above plant, appropriately moisture conditioned and compacted using several passes.

To the extent that was reasonably practicable, fill materials visibly containing excessive amounts of silts or deleterious materials such as sticks, oversize particles were sorted to remove the contaminants prior to placement, or rejected for use. Some cobble sized particles may remain in the body of the fill, however, are unlikely to be in sufficient quantities to adversely affect the performance of the new fill. Sloping areas requiring filling were benched and continually keyed into the slope prior to and during fill placement.

Picture 2: View of Filling Operations



5.0 COMPACTION TESTING

Compaction testing was carried out on the compacted fill materials in accordance with Table 5.1 and 8.1 of AS3798 2007 and tested to AS1289 test methods. All test locations were selected by Qualtest at random and staggered over the fill area and depth. Test locations were not obtained by survey and on this basis, the locations should be considered as approximate only.

Compaction testing achieved the minimum required compaction specification of 95% Standard at the test locations. Areas where the compaction specification was not achieved were reworked and re-tested using random stratified location processes.

The location of the compaction tests and area of fill covered under this report are shown on the Site Plan contained in Appendix A. Compaction test reports are contained in Appendix B.

6.0 STATEMENT OF COMPLIANCE

Our representatives observed the relevant earthworks operations during our engagement including the stripped surface, new fill placement and compaction operations, and compaction testing.

As far as Qualtest could assess, the fill at The Site has been observed to be placed and compacted in accordance with the requirements outlined in Section 2.0.

The fill at The Site can be considered to be "Controlled" as defined in AS2870.

7.0 EXCLUSIONS

The compliance statement specifically excludes any topsoil, which may be placed for use as Lot dressing or any other subsequent earthworks after 31st July 2024. All trench backfill, landscaping fill, fill outside the area shown as Figure 2 and other fill placed without our knowledge is also excluded.

Assessments of batter stability, global stability, and material quality such as soaked CBR and site classifications are excluded from this commission. The stability of any fill batters in the long term must take account of the variable materials used for the construction of the fill platforms and all surface loads including traffic loads near the crest of all batters.


Our on-site attendance specifically excludes assessments of fill material quality and engineering properties that are outside the requirements of AS3798 - 2007, including soil or fill reactivity and soaked CBR values. We note that the fill materials comprise clay soils, which may result in unfavourable site classifications for individual lots and low subgrade design strengths for pavements.

Footings and ground slabs for any structures constructed over natural soils or controlled fill should be designed to accommodate the characteristic ground surface movements and settlement potential. Assessments of these design parameters are beyond the scope of this Report.

Controlled fill (Level 1 Fill) provides an overview that the Earthwork Specification has been met. There are instances where significant long-term settlements of controlled fill can occur. Large total and differential settlements can be expected where fill has been placed over soft and compressible soils and where the thickness of controlled fill varies significantly across a lot.

Should you require further information regarding the above please do not hesitate to contact this office.

Yours faithfully,



MICHAEL MORRISON

For and on behalf of

QUALTEST LABORATORY PTY LTD.

Appendix A – Test Location Markup

Appendix B – Test Reports


Appendix C – Previous Level One Report

APPENDIX A

Site Plan and Compaction Test Locations



Qualtest Laboratory
Est. 1987

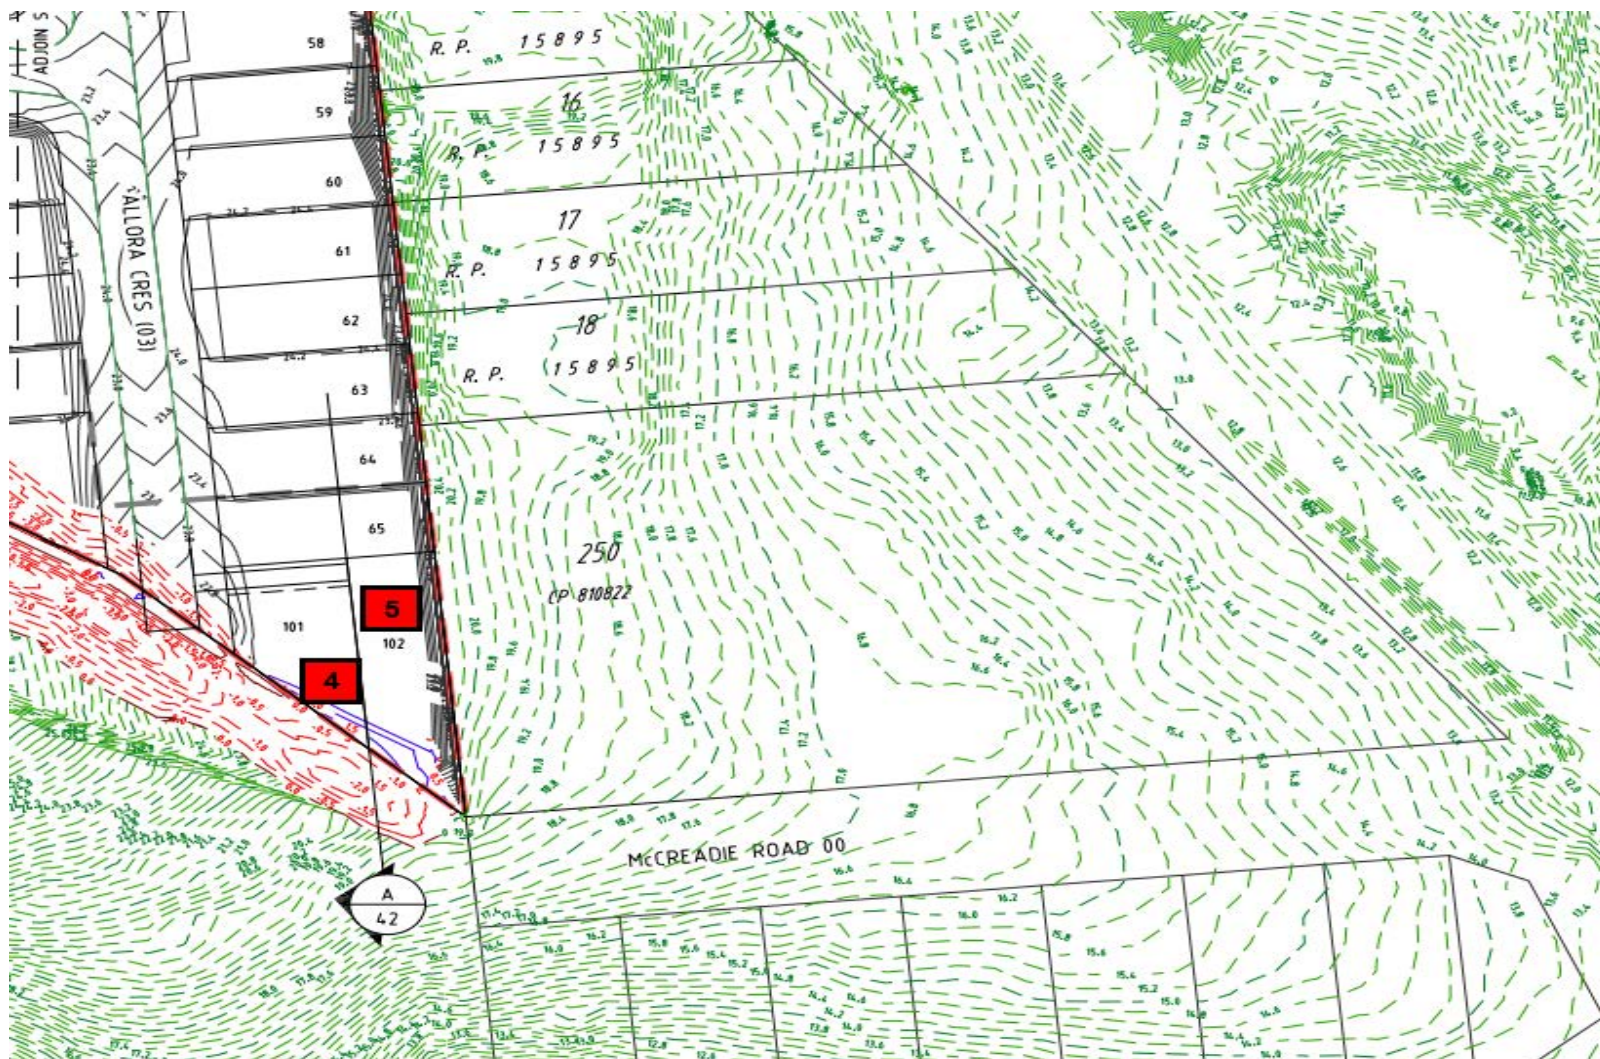

Qualtest Laboratory

Est. 1987

LEGEND:

Test Locations



CLIENT: Winslow

LOCATION: Elevate Stage 2B – Ormeau Hills

TITLE: Compaction Test Locations

DRAWING NO: 24-294-01

DATE: 11th October 2024

PROJECT NO: 24-294

CHECKED BY: GG



Qualtest Laboratory

Est. 1987

LEGEND:

Test Locations



CLIENT: Winslow

TITLE: Compaction Test Locations

DRAWING NO: 24-294-02

DATE: 11th October 2024

LOCATION: Elevate Stage 2B – Ormeau Hills

PROJECT NO: 24-294

CHECKED BY: GG

APPENDIX B

COMPACTION TEST REPORTS

Material Test Report

Report Number: 24-294_a-1
Issue Number: 1
Date Issued: 29/07/2024
Client: WINSLOW
BUILDING 4, G1, 107 MILES PLATTING RD, EIGHT MILE PLAINS QLD 4113
Contact: JOSH BARKER
Project Number: 24-294_a
Project Name: LEVEL ONE SUPERVISION
Project Location: ELEVATE STAGE 2B - ORMEAU
Client Reference: 65317
Work Request: 11311
Date Sampled: 24/07/2024 7:00
Dates Tested: 24/07/2024 - 26/07/2024
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Preparation Method: AS 1289.1.1 - Sampling and Preparation of Soils
Specification: 95% Standard
Location: Elevate Stage 2B Ormeau Hills
Material: Allotment Fill
Material Source: On Site



Qualtest Laboratory Pty Ltd
Brisbane Laboratory
2 / 40 Boyland Ave Cooper Plains QLD 4108
Phone: 0417 011 515
Email: greg@qualtestgeo.com

Accredited for compliance with ISO/IEC 17025 - Testing



Approved Signatory: Greg Gibson
ql-greg

NATA Accredited Laboratory Number: 2316

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1			
Sample Number	S11311A	S11311B	
Test Number	3	4	
Date Tested	24/07/2024	24/07/2024	
Time Tested	11:30	13:50	
Test Request #/Location	Lot 102	Lot 101	
Line / Offset	6m off East Boundary	3m off South Batter	
Offset	24m off South Boundary	22m off East Boundary	
Layer / Reduced Level	Final Level	Final Level	
Thickness of Layer (mm)	175	175	
Soil Description	On Site	On Site	
Test Depth (mm)	150	150	
Sieve used to determine oversize (mm)	19.0	19.0	
Percentage of Wet Oversize (%)	10	20	
Field Wet Density (FWD) t/m ³	1.88	2.01	
Field Moisture Content %	8.9	10.0	
Field Dry Density (FDD) t/m ³	1.72	1.83	
Peak Converted Wet Density t/m ³	**	**	
Adjusted Peak Converted Wet Density t/m ³	2.06	2.11	
Moisture Variation (Wv) %	**	**	
Adjusted Moisture Variation %	3.0	1.0	
Hilf Density Ratio (%)	91.0	95.0	
Compaction Method	Standard	Standard	
Report Remarks	**	**	

Moisture Variation Note:

Positive values = test is dry of OMC

Negative values = test is wet of OMC

Material Test Report

Report Number: 24-294_a-2
Issue Number: 1
Date Issued: 14/08/2024
Client: WINSLOW
BUILDING 4, G1, 107 MILES PLATTING RD, EIGHT MILE PLAINS QLD 4113
Contact: JOSH BARKER
Project Number: 24-294_a
Project Name: LEVEL ONE SUPERVISION
Project Location: ELEVATE STAGE 2B - ORMEAU
Client Reference: 65317
Work Request: 11131
Date Sampled: 16/07/2024
Dates Tested: 16/07/2024 - 23/07/2024
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Preparation Method: AS 1289.1.1 - Sampling and Preparation of Soils
Specification: 95% Standard
Site Selection: Selected by GTA
Material: General Fill
Material Source: Onsite



Qualtest Laboratory Pty Ltd
Brisbane Laboratory
2 / 40 Boyland Ave Cooper Plains QLD 4108
Phone: 0417 011 515
Email: rhys@qualtestgeo.com

Accredited for compliance with ISO/IEC 17025 - Testing



Approved Signatory: Rhys Mitchell
Field Technician
NATA Accredited Laboratory Number: 2316

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1			
Sample Number	S11131A	S11131B	
Test Number	1	2	
Date Tested	16/07/2024	16/07/2024	
Time Tested	12:15	12:20	
Test Request #/Location	Lot 92	Lot 92	
Easting	6m from South Boundary	8m from North Boundary	
Northing	1m from East Boundary	2m from East Boundary	
Layer / Reduced Level	0.4m Below FL	Final Level	
Thickness of Layer (mm)	200	200	
Soil Description	Clayey Gravel	Clayey Gravel	
Test Depth (mm)	175	175	
Sieve used to determine oversize (mm)	19.0	19.0	
Percentage of Wet Oversize (%)	18	27	
Field Wet Density (FWD) t/m ³	2.16	2.17	
Field Moisture Content %	9.3	8.7	
Field Dry Density (FDD) t/m ³	1.97	2.00	
Peak Converted Wet Density t/m ³	**	**	
Adjusted Peak Converted Wet Density t/m ³	2.26	2.28	
Moisture Variation (Wv) %	**	**	
Adjusted Moisture Variation %	0.0	0.0	
Hilf Density Ratio (%)	95.5	95.0	
Compaction Method	Standard	Standard	
Report Remarks	**	**	

Moisture Variation Note:

Positive values = test is dry of OMC
Negative values = test is wet of OMC

Material Test Report

Report Number: 24-294_a-3
Issue Number: 1
Date Issued: 16/08/2024
Client: WINSLOW
BUILDING 4, G1, 107 MILES PLATTING RD, EIGHT MILE PLAINS QLD 4113
Contact: JOSH BARKER
Project Number: 24-294_a
Project Name: LEVEL ONE SUPERVISION
Project Location: ELEVATE STAGE 2B - ORMEAU
Client Reference: 65317
Work Request: 11393
Date Sampled: 24/07/2024 8:00
Dates Tested: 31/07/2024 - 31/07/2024
Sampling Method: AS 1289.1.2.1 6.4 (b) - Sampling from layers in earthworks or pavement - compacted
Preparation Method: AS 1289.1.1 - Sampling and Preparation of Soils
Specification: 95% Standard
Site Selection: Selected by GTA
Location: Elevate Stage 2B Ormeau Hills
Material: Allotment Fill
Material Source: On Site



Qualtest Laboratory Pty Ltd
Brisbane Laboratory
2 / 40 Boyland Ave Cooper Plains QLD 4108
Phone: 0417 011 515
Email: rhys@qualtestgeo.com

Accredited for compliance with ISO/IEC 17025 - Testing



Approved Signatory: Rhys Mitchell
Field Technician

NATA Accredited Laboratory Number: 2316

Compaction Control AS 1289 5.7.1 & 5.8.1 & 2.1.1			
Sample Number	S11393A		
Test Number	5		
Date Tested	31/07/2024		
Time Tested	09:50		
Test Request #/Location	Lot 102 - (Retest of WR 11311)		
Line / Offset	26m off South Boundary		
Offset	5m off East Boundary		
Layer / Reduced Level	Final Level		
Thickness of Layer (mm)	175		
Soil Description	On Site		
Test Depth (mm)	150		
Sieve used to determine oversize (mm)	19.0		
Percentage of Wet Oversize (%)	21		
Field Wet Density (FWD) t/m ³	1.98		
Field Moisture Content %	11.0		
Field Dry Density (FDD) t/m ³	1.78		
Peak Converted Wet Density t/m ³	**		
Adjusted Peak Converted Wet Density t/m ³	2.03		
Moisture Variation (Wv) %	**		
Adjusted Moisture Variation %	0.0		
Hilf Density Ratio (%)	97.5		
Compaction Method	Standard		
Report Remarks	**		

Moisture Variation Note:

Positive values = test is dry of OMC

Negative values = test is wet of OMC

APPENDIX C

Previous Level One Report



Qualtest Laboratory
Est. 1987

WORKS INSPECTION & TESTING

PROPOSED
RESIDENTIAL
DEVELOPMENT

LOT 4 DALMA
STREET

ORMEAU

JOB NO: P1078 comp01



Prepared for
CCA Winslow

16th October 2019

Document Information

Prepared for CCA Winslow
Project Name Proposed Residential Development - Lot 4 Dalma Street, Ormeau
Job Number P1078
Date 16th October 2019

Document Control

Document Control

- This Document Is:-

ORIGINAL

☐

COPY

☐

Report ID	Date	Author	Reviewer			
P1078 comp 01	16/10/19	Mathew Tyrrell	Andrew Dickie			
Distributed to:			No.	Original	Copy	Electronic
CCA Winslow			3	✓	✓	✓
Construction Sciences - Archives			1			✓

Contact : Mathew Tyrrell

mathew.tyrrell@constructionsciences.net

PO Box 2789

NERANG QLD 4211

Ph: 07 5597 2720

© Construction Sciences 2017. Copyright in the whole and every part of this document belongs to CS and may not be used, sold, transferred, copied or reproduced in whole or in part in any manner or form or in or on any media to any person other than by agreement with CS.

This document is produced by CS solely for the benefit and use by the client in accordance with the terms of the engagement. CS does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by any third party on the content of this document.

Table of Contents

INTRODUCTION	4
SCOPE OF WORKS	4
Level 1	
SPECIFICATION REQUIREMENTS	4
SITE WORKS - BULK EARTHWORKS	5
General	
Compaction Control Testing	
CONCLUSION	5
 SITE PHOTOGRAPHS	

Appendices

Appendix A Bulk Earthworks - Compaction

INTRODUCTION

Construction Sciences was commissioned by **CCA Winslow** to carry out the geotechnical inspection and testing required for a proposed residential development at Lot 4 Dalma Street, Ormeau which was carried out between 17th July and 1st October 2019.

SCOPE OF WORKS

Works on this development were monitored in accordance with the scope of our commission as follows:-

Level 1 : Bulk earthworks stripping and filling was inspected and tested on a Level 1 basis, in accordance with AS 3798.

Scope of Level 1 responsibility: ***“The primary objective of Level 1 Inspection and Testing is for the geotechnical inspection and testing authority (GITA) to be able to express an opinion on the compliance of the work. The GITA is responsible for ensuring that the inspection and testing is sufficient for this purpose.***

The GITA needs to have competent personnel on site at all times while earthwork operations are undertaken. Such operations include the following:

- (a) Completion of removal of topsoil.***
- (b) Placing of imported or cut material.***
- (c) Compaction and adding/removal of moisture.***
- (d) Trenching and backfilling, where applicable.***
- (e) Test rolling.***
- (f) Testing.***

The superintendent should agree on a suitable inspection and testing plan prior to the commencement of the works”.

reference AS3798 – Section 8.2

SPECIFICATION REQUIREMENTS

Earthworks on this development was inspected and tested in accordance with the specification of the design engineer, **Mortons Urban Solutions** and / or to the specifications of the local authority, **City of Gold Coast**.

The following table is a summary of the basic compaction requirements for the project.

Testing procedures used to confirm that these requirements were met were all in accordance with Australian Standard test methods.

SPECIFICATIONS	
<i>Item</i>	<i>Minimum Compaction Requirement</i>
<i>Bulk Earthworks Fill</i>	<i>95% Wet Density Ratio – Standard</i>

SITE WORKS - BULK EARTHWORKS

General : Full time site inspection was maintained in accordance with Level 1 requirements whilst earthworks were carried out on this development.

The natural ground in the areas of filling generally comprised medium to high plasticity residual clays, silty or sandy clays and weathered rock.

The material used in the bulk earthworks filling was sourced from site cutting to design levels.

Compaction Control Testing : Compaction control testing via the nuclear densometer method was carried out at regular intervals throughout the placement of fill, in accordance with the minimum test frequency recommendations included in AS3798 "Guidelines on Earthworks for Commercial and Residential Developments".

Forty Four (44) field density tests were carried out throughout the earthworks. The average wet density ratio was recorded to be 100.0%. Approximate test locations are shown on attached sketch P1078 SK1 included in Appendix A. Test reports are also included in Appendix A.

CONCLUSION

We confirm that:

(a) Our representative was in full time site attendance whilst bulk earthworks filling was in progress between 17th July and 1st October 2019 at :- Lot 4 Dalma Street, Ormeau.

(b) Pre – fill ground preparation was carried out in accordance with the specifications and site instruction given.

(c) The structural filling placed to design levels (per supplied construction drawing numbers 35701-CLL-040D to CLL-042C & 35701-CLL-050C to CLL-054C) during the term of our engagement on a "Level 1" basis can be termed "controlled filling".

(d) The results of the compaction control testing indicate that the fill placed during the term of our site attendance, was compacted to at least the minimum specified wet density ratio.

(e) All test results pertaining to the development are included within appendix A to C of this report.



MATHEW TYRRELL
LABORATORY SUPERVISOR
Construction Sciences





Unsuitable Material - excavated & removed





Oversized rock/boulders encountered - removed from area to be filled































APPENDIX

A

BULK EARTHWORKS
FILL



**Construction
Sciences**

TABLE 1 : SUMMARY OF BULK EARTHWORKS FILL FIELD DENSITY TESTING

CLIENT : CCA WINSLOW

JOB NO: P1078

PROJECT : LOT 4 DALMA STREET - ORMEAU

Mean %: 100.0

SITE TEST No.	GENERAL LOCATION	EASTING	NORTHING	ELEVATION LEVEL / RL	WET DENSITY RATIO (%)	
						FAILED TESTS RETESTED
13385/S/ 90107	Lot 4	525468.0	6925286.0	RL 22.61	96.5	
13385/S/ 90395	Lot 66	525478.2	6925262.2	RL 22.99	101.5	
13385/S/ 90288	Lot 4	525475.1	6925258.3	RL 23.22	100.5	
13385/S/ 90289	Lot 4	525468.5	6925263.1	RL 23.23	99.0	
13385/S/ 90286	Lot 4	525481.2	6925239.2	RL 21.80	100.5	
13385/S/ 90287	Lot 4	525478.2	6925263.8	RL 21.85	98.5	
13385/S/ 90478	Lot 63	525464.5	6925304.8	RL 23.60	100.5	
13385/S/ 90752	Lot 24	525391.4	6925595.3	RL 17.20	98.5	
13385/S/ 90810	Lot 22	525338.0	6925588.5	RL 17.58	100.0	
13385/S/ 90919	Lot 21	525304.1	6925582.4	RL 19.20	101.5	
13385/S/ 90920	Lot 20	525326.8	6925582.9	RL 18.93	98.0	
13385/S/ 91185	Lot 61	525467.2	6925358.0	RL 23.06	95.0	
13385/S/ 91086	Lot 61	525471.3	6925331.1	RL 22.79	98.5	
13385/S/ 91087	Lot 62	525470.5	6925322.3	RL 23.12	99.5	
13385/S/ 91226	Lot 60	525478.1	6925360.3	RL 22.58	101.5	
13385/S/ 91455	Lot 57	525468.9	6925384.3	RL 22.32	99.0	
13385/S/ 91456	Lot 900 Eastern Side	525470.0	6925435.3	RL 20.09	101.5	
13385/S/ 91385	Lot 59	525457.9	6925364.8	RL 22.37	98.5	
13385/S/ 91386	Lot 23	525385.6	6925591.3	RL 17.99	101.5	
13385/S/ 91879	Lot 56	525468.6	6925386.1	RL 23.32	100.0	
13385/S/ 91880	Lot 54	525466.0	6925406.1	RL 21.56	101.5	
13385/S/ 92517	Lot 76	525313.2	6925395.2	RL 34.58	100.5	
13385/S/ 92737	Lot 10	525325.6	6925457.0	RL 25.58	100.5	
13385/S/ 92738	Lot 44	525296.8	6925465.5	RL 25.78	101.0	
13385/S/ 92917	Lot 44	525350.3	6925460.4	RL 26.30	99.0	
13385/S/ 92918	Lot 45	525336.7	6925453.6	RL 26.19	100.0	
13385/S/ 92919	Road 2	525308.0	6925461.3	RL 26.70	101.0	
13385/S/ 93183	Lot 10	525292.0	6925456.8	RL 29.30	102.0	
13385/S/ 93184	Lot 45	525327.7	6925457.9	RL 26.88	99.0	
13385/S/ 92961	Lot 11	525295.9	6925471.1	RL 26.69	101.0	
13385/S/ 92962	Road 2	525309.8	6925468.4	RL 26.89	98.0	
13385/S/ 93126	Lot 12	525295.0	6925479.6	RL 26.91	100.5	
13385/S/ 93127	Lot 11	525293.9	6925469.1	RL 27.62	100.5	
13385/S/ 93373	Lot 46	525339.8	6925465.0	RL 26.98	101.0	
13385/S/ 93751	Lot 45	525334.6	6925453.0	RL 27.91	99.5	
13385/S/ 93752	Lot 44	525319.8	6925453.8	RL 28.35	99.0	
13385/S/ 93582	Lot 34	525437.3	6925471.8	RL 20.86	99.0	
13385/S/ 94381	Lot 83	525398.8	6925376.5	RL 25.60	102.0	
13385/S/ 94382	Lot 45	525333.6	6925454.0	RL 28.30	103.0	
13385/S/ 95257	Lot 24	525399.0	6925595.8	RL 17.67	102.0	
13385/S/ 95258	Lot 22	525373.9	6925581.5	RL 17.87	101.0	
13385/S/ 95259	Lot 21	525344.0	6925590.4	RL 18.23	100.5	
13385/S/ 95615	Lot 32	525387.0	6925532.6	RL 22.96	102.0	
13385/S/ 95616	Lot 24	525387.4	6925595.1	RL 18.32	98.5	



⊕ denotes approx field density test location

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33347-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/18898
Component:	Bulk Earthworks	Client Reference/s:	WR: 19849
Area Description:	Lot 4 Dalma Street	Report Date / Page:	23/07/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90107			
ID / Client ID	-			
Lot Number	-			
Date / Time Tested	19/07/2019			
Material Source	Site Won - Cut to Fill			
Material Type	General Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	300 / 300+ / 300+			
Standard or Modified	Standard			
Location	Lot 4			
Easting	525468			
Northing	6925286			
Level	RL 22.614			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	17			
Compaction Sample Number	13385/S/90107			
Sample Description	CL SILTY CLAY w- gravel brown			
Moisture Test Results:				
Field Moisture Content (%)	9.6			
Adjusted / Moisture Variation (%)	2.0			
Optimum Moisture Content (%)	11.5			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	82.0			
Density Test Results:				
Field Wet Density (t/m³)	2.03			
Adj/Peak Conv Wet Density (t/m³)	2.10			
Density Ratio Required (%)	95			
Half Density Ratio (%)	96.5			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33412-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/18953
Component:	Bulk Earthworks	Client Reference/s:	WR: 20253
Area Description:	Lot 4 Dalma Street	Report Date / Page:	26/07/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90396			
ID / Client ID	WR: 20253			
Lot Number	-			
Date / Time Tested	24/07/2019 10:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / -			
Standard or Modified	Standard			
Location	Lot 66			
Easting	525478.195			
Northing	6925262.154			
Level	22.991			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	6			
Compaction Sample Number	13385/S/90396			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	9.4			
Adjusted / Moisture Variation (%)	2.5			
Optimum Moisture Content (%)	12.0			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	77.5			
Density Test Results:				
Field Wet Density (t/m³)	2.37			
Adj/Peak Conv Wet Density (t/m³)	2.33			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	101.5			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33417-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/18938
Component:	Bulk Earthworks	Client Reference/s:	-
Area Description:	Lot 4	Report Date / Page:	26/07/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90288	13385/S/90289		
ID / Client ID	-	-		
Lot Number	-	-		
Date / Time Tested	23/07/2019 13:00	23/07/2019 16:45		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 4	Lot 4		
Easting	525475.061	525468.480		
Northing	6925258.291	6925263.113		
Level	RL: 23.221	RL 23.226		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	5	5		
Compaction Sample Number	13385/S/90288	13385/S/90289		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	9.8	9.2		
Adjusted / Moisture Variation (%)	2.5	2.5		
Optimum Moisture Content (%)	12.5	12.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	79.5	77.5		
Density Test Results:				
Field Wet Density (t/m ³)	2.21	2.15		
Adj/Peak Conv Wet Density (t/m ³)	2.20	2.18		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	100.5	99.0		

Remarks



The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

Accreditation Number: 1986
Corporate Site Number: 13385

Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33418-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/18937
Component:	Bulk Earthworks	Client Reference/s:	WR: 19850
Area Description:	Lot 4 Dalma Street	Report Date / Page:	26/07/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90286	13385/S/90287		
ID / Client ID	-	-		
Lot Number	-	-		
Date / Time Tested	22/07/2019 13:00	22/07/2019 13:20		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 4	Lot 4		
Easting	525481.966	525478.153		
Northing	6925239.176	6925263.792		
Level	RL: 21.800	RL: 21.848		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	0	0		
Compaction Sample Number	13385/S/90286	13385/S/90287		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	8.7	8.2		
Adjusted / Moisture Variation (%)	2.5	2.5		
Optimum Moisture Content (%)	11.5	11.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	77.0	76.0		
Density Test Results:				
Field Wet Density (t/m³)	2.22	2.13		
Adj/Peak Conv Wet Density (t/m³)	2.20	2.16		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	100.5	98.5		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33494-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/18974
Component:	Bulk Earthworks	Client Reference/s:	WR 20255
Area Description:	Lot 4 Dalma Street	Report Date / Page:	30/07/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90478			
ID / Client ID	-			
Lot Number	-			
Date / Time Tested	25/07/2019 13:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 63			
Easting	525464.514			
Northing	6925304.782			
Level	RL 23.600			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	6			
Compaction Sample Number	13385/S/90478			
Sample Description	GC CLayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	11.1			
Adjusted / Moisture Variation (%)	2.5			
Optimum Moisture Content (%)	13.5			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	82.0			
Density Test Results:				
Field Wet Density (t/m³)	2.20			
Adj/Peak Conv Wet Density (t/m³)	2.18			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	100.5			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33585-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19016
Component:	Bulk Earthworks	Client Reference/s:	WR 20258
Area Description:	Dalma Street, Ormeau Lot 4	Report Date / Page:	1/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90752			
ID / Client ID	-			
Lot Number	-			
Date / Time Tested	30/07/2019 13:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / -			
Standard or Modified	Standard			
Location	Lot 24			
Easting	525391.427			
Northing	6925595.336			
Level	RL 17.196			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	0			
Compaction Sample Number	13385/S/90752			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	10.9			
Adjusted / Moisture Variation (%)	2.0			
Optimum Moisture Content (%)	13.0			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	83.0			
Density Test Results:				
Field Wet Density (t/m³)	2.14			
Adj/Peak Conv Wet Density (t/m³)	2.18			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	98.5			

Remarks

<div style="display: flex; align-items: center;">  <div> <p>The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards. Accredited for compliance with ISO/IEC 17025 - Testing</p> <p>Accreditation Number: 1986 Corporate Site Number: 13385</p> </div> </div>	<div style="text-align: center;">  <p>Approved Signatory: Andrew Dickie Form ID: W5ASRep Rev 2</p> </div>
--	--



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33595-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19024
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20259
Area Description:	Dalma Street, Ormeau Lot 4	Report Date / Page:	2/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90810			
ID / Client ID	WR 20259			
Lot Number	-			
Date / Time Tested	31/07/2019 13:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / -			
Standard or Modified	Standard			
Location	Lot 22			
Easting	525338.040			
Northing	6925588.450			
Level	RL 17.580			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	0			
Compaction Sample Number	13385/S/90810			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	6.9			
Adjusted / Moisture Variation (%)	2.5			
Optimum Moisture Content (%)	9.5			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	72.0			
Density Test Results:				
Field Wet Density (t/m³)	2.14			
Adj/Peak Conv Wet Density (t/m³)	2.13			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	100.0			

Remarks

 <p>The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards. Accredited for compliance with ISO/IEC 17025 - Testing</p> <p>Accreditation Number: 1986 Corporate Site Number: 13385</p>	 <p>Approved Signatory: Andrew Dickie Form ID: W5ASRep Rev 2</p>
--	---

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33610-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19043
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20260
Area Description:	Dalma Street, Ormeau Lot 4	Report Date / Page:	5/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/90919	13385/S/90920		
ID / Client ID	WR 20260	WR 20260		
Lot Number	-	-		
Date / Time Tested	1/08/2019 10:05	1/08/2019 10:10		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 21	Lot 20		
Easting	525304.104	525326.803		
Northing	6925582.369	6925582.904		
Level	RL 19.198	RL 18.930		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	13	13		
Compaction Sample Number	13385/S/90919	13385/S/90920		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	8.6	11.6		
Adjusted / Moisture Variation (%)	2.0	2.0		
Optimum Moisture Content (%)	11.0	14.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	79.5	82.5		
Density Test Results:				
Field Wet Density (t/m³)	2.11	2.16		
Adj/Peak Conv Wet Density (t/m³)	2.08	2.20		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	101.5	98.0		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33655-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19079
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20262
Area Description:	Dalma St, Ormeau Lot 4	Report Date / Page:	7/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91185			
ID / Client ID	WR 20262			
Lot Number	-			
Date / Time Tested	5/08/2019 10:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 61			
Easting	525467.225			
Northing	6925357.982			
Level	RL 23.060			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	19			
Compaction Sample Number	13385/S/91185			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	8.8			
Adjusted / Moisture Variation (%)	2.0			
Optimum Moisture Content (%)	11.0			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	80.5			
Density Test Results:				
Field Wet Density (t/m³)	2.13			
Adj/Peak Conv Wet Density (t/m³)	2.24			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	95.0			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33657-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19062
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20261
Area Description:	Dalma Street, Ormeau Lot 4	Report Date / Page:	7/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91086	13385/S/91087		
ID / Client ID	WR 20261	WR 20261		
Lot Number	-	-		
Date / Time Tested	2/08/2019 10:05	2/08/2019 13:05		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / -	175 / 200 / -		
Standard or Modified	Standard	Standard		
Location	Lot 61	Lot 62		
Easting	525471.347	525470.479		
Northing	6925331.124	6925322.262		
Level	RL 22.789	RL 23.122		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	17	16		
Compaction Sample Number	13385/S/91086	13385/S/91087		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	11.2	6.0		
Adjusted / Moisture Variation (%)	2.0	2.0		
Optimum Moisture Content (%)	13.5	8.5		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	83.5	72.5		
Density Test Results:				
Field Wet Density (t/m³)	2.13	2.15		
Adj/Peak Conv Wet Density (t/m³)	2.16	2.17		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	98.5	99.5		

Remarks



The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

Accreditation Number: 1986
Corporate Site Number: 13385



Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33683-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19094
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20263
Area Description:	Dalma St, Ormeau Lot 4	Report Date / Page:	7/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91226			
ID / Client ID	WR 20263			
Lot Number	-			
Date / Time Tested	6/08/2019 10:05			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 60			
Easting	525478.129			
Northing	6925360.299			
Level	RL 22.580			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	7			
Compaction Sample Number	13385/S/91226			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	7.5			
Adjusted / Moisture Variation (%)	2.5			
Optimum Moisture Content (%)	10.0			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	75.0			
Density Test Results:				
Field Wet Density (t/m³)	2.16			
Adj/Peak Conv Wet Density (t/m³)	2.13			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	101.5			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33791-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19130
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20265
Area Description:	Dalma St, Ormeau Lot 4	Report Date / Page:	12/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91455	13385/S/91456		
ID / Client ID	WR 20265	WR 20265		
Lot Number	-	-		
Date / Time Tested	8/08/2019 10:05	8/08/2019 10:15		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 57	Lot 900 Eastern Side		
Easting	525468.947	525469.998		
Northing	6925384.288	6925435.331		
Level	RL 22.316	RL 20.088		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	14	5		
Compaction Sample Number	13385/S/91455	13385/S/91456		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	15.2	9.8		
Adjusted / Moisture Variation (%)	2.0	2.0		
Optimum Moisture Content (%)	17.5	12.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	87.5	82.5		
Density Test Results:				
Field Wet Density (t/m³)	2.12	2.15		
Adj/Peak Conv Wet Density (t/m³)	2.15	2.12		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	99.0	101.5		

Remarks

	The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards. Accredited for compliance with ISO/IEC 17025 - Testing		
	Accreditation Number:	1986	
	Corporate Site Number:	13385	
	Approved Signatory: Andrew Dickie		Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33797-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19119
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20264
Area Description:	Dalma St, Ormeau Lot 4	Report Date / Page:	13/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91385	13385/S/91386		
ID / Client ID	WR 20264	WR 20264		
Lot Number	-	-		
Date / Time Tested	7/08/2019 10:05	7/08/2019 13:05		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 59	Lot 23		
Easting	525457.926	525385.575		
Northing	6925364.843	6925591.296		
Level	RL 22.371	RL 17.988		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	10	7		
Compaction Sample Number	13385/S/91385	13385/S/91386		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	11.2	10.6		
Adjusted / Moisture Variation (%)	2.0	2.5		
Optimum Moisture Content (%)	13.5	13.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	82.5	81.0		
Density Test Results:				
Field Wet Density (t/m³)	2.13	2.13		
Adj/Peak Conv Wet Density (t/m³)	2.16	2.10		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	98.5	101.5		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/33898-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19201
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20270
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	16/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/91879	13385/S/91880		
ID / Client ID	WR 20270	WR 20270		
Lot Number	-	-		
Date / Time Tested	14/08/2019 10:05	14/08/2019 10:15		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / -	175 / 200 / -		
Standard or Modified	Standard	Standard		
Location	Lot 56	Lot 54		
Easting	525468.572	525466.005		
Northing	6925386.077	6925406.123		
Level	RL 22.320	RL 21.560		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	14	12		
Compaction Sample Number	13385/S/91879	13385/S/91880		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	7.4	7.3		
Adjusted / Moisture Variation (%)	2.0	2.0		
Optimum Moisture Content (%)	9.5	9.5		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	78.0	76.0		
Density Test Results:				
Field Wet Density (t/m³)	2.13	2.12		
Adj/Peak Conv Wet Density (t/m³)	2.13	2.09		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	100.0	101.5		

Remarks

	The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards. Accredited for compliance with ISO/IEC 17025 - Testing		
	Accreditation Number:	1986	
	Corporate Site Number:	13385	
	Approved Signatory: Andrew Dickie		
	Form ID: W5ASRep Rev 2		



WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34117-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19300
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20272
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	27/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/92517			
ID / Client ID	WR 20272			
Lot Number	-			
Date / Time Tested	21/08/2019 10:15			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 76			
Easting	525313.232			
Northing	6925395.225			
Level	RL 34.580			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	7			
Compaction Sample Number	13385/S/92517			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	8.5			
Adjusted / Moisture Variation (%)	2.5			
Optimum Moisture Content (%)	11.0			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	78.0			
Density Test Results:				
Field Wet Density (t/m³)	2.10			
Adj/Peak Conv Wet Density (t/m³)	2.09			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	100.5			

Remarks

<div style="display: flex; align-items: center;">  <div> <p>The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards. Accredited for compliance with ISO/IEC 17025 - Testing</p> <p>Accreditation Number: 1986 Corporate Site Number: 13385</p> </div> </div>	<div style="text-align: center;">  <p>Approved Signatory: Andrew Dickie Form ID: W5ASRep Rev 2</p> </div>
--	--

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34118-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19326
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20273
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	27/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/92737	13385/S/92738		
ID / Client ID	WR 20273	WR 20273		
Lot Number	-	-		
Date / Time Tested	22/08/2019 10:05	22/08/2019 10:20		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 10	Lot 44		
Easting	525325.564	525296.795		
Northing	6925457.036	6925465.464		
Level	RL 25.583	RL 25.780		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	10	11		
Compaction Sample Number	13385/S/92737	13385/S/92738		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	8.8	8.9		
Adjusted / Moisture Variation (%)	4.0	4.0		
Optimum Moisture Content (%)	13.0	13.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	67.5	68.5		
Density Test Results:				
Field Wet Density (t/m³)	2.07	2.09		
Adj/Peak Conv Wet Density (t/m³)	2.06	2.07		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	100.5	101.0		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34120-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19352
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20274
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	27/08/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/92917	13385/S/92918	13385/S/92919	
ID / Client ID	WR 20274	WR 20274	WR 20274	
Lot Number	-	-	-	
Date / Time Tested	26/08/2019 07:30	26/08/2019 07:50	26/08/2019 10:05	
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill	Site Won - Cut to Fill	
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill	Bulk Earthworks Fill	
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b	
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200	175 / 200 / 200	
Standard or Modified	Standard	Standard	Standard	
Location	Lot 44	Lot 45	Road 02	
Easting	525350.330	525336.670	525307.970	
Northing	6925460.386	6925453.603	6925461.305	
Level	RL 26.300	RL 26.186	RL 26.700	
Test Fraction (mm)	< 19.0 mm	< 19.0 mm	< 19.0 mm	
Sample Oversize (%)	5	6	9	
Compaction Sample Number	13385/S/92917	13385/S/92918	13385/S/92919	
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown	
Moisture Test Results:				
Field Moisture Content (%)	9.8	9.8	12.5	
Adjusted / Moisture Variation (%)	2.0	2.0	2.0	
Optimum Moisture Content (%)	12.0	12.0	15.0	
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)	(Drier than OMC)	
Moisture Ratio (%)	81.0	81.0	83.5	
Density Test Results:				
Field Wet Density (t/m³)	2.12	2.12	2.19	
Adj/Peak Conv Wet Density (t/m³)	2.14	2.12	2.17	
Density Ratio Required (%)	95	95	95	
Hilf Density Ratio (%)	99.0	100.0	101.0	

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34218-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19390
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20277
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	2/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/93183	13385/S/93184		
ID / Client ID	WR 20277	WR 20277		
Lot Number	-	-		
Date / Time Tested	28/08/2019 10:05	28/08/2019 13:05		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / -	175 / 200 / -		
Standard or Modified	Standard	Standard		
Location	Lot 10	Lot 45		
Easting	525292.023	525327.674		
Northing	6925456.840	6925457.917		
Level	RL 29.300	RL 26.879		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	9	12		
Compaction Sample Number	13385/S/93183	13385/S/93184		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	9.9	9.9		
Adjusted / Moisture Variation (%)	2.0	2.0		
Optimum Moisture Content (%)	12.0	12.5		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	81.0	80.5		
Density Test Results:				
Field Wet Density (t/m³)	2.31	2.13		
Adj/Peak Conv Wet Density (t/m³)	2.26	2.15		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	102.0	99.0		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34221-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19358
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20275
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	2/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/92961	13385/S/92962		
ID / Client ID	WR 20275	WR 20275		
Lot Number	-	-		
Date / Time Tested	26/08/2019 10:05	26/08/2019 10:15		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 11	Road 02		
Easting	525295.870	525309.823		
Northing	6925471.116	6925468.368		
Level	RL 26.685	RL 26.890		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	10	13		
Compaction Sample Number	13385/S/92961	13385/S/92962		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	6.4	9.7		
Adjusted / Moisture Variation (%)	4.0	2.0		
Optimum Moisture Content (%)	10.5	12.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	60.0	81.0		
Density Test Results:				
Field Wet Density (t/m³)	2.10	2.11		
Adj/Peak Conv Wet Density (t/m³)	2.08	2.15		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	101.0	98.0		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34260-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19378
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20276
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	3/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/93126	13385/S/93127		
ID / Client ID	WR 20276	WR 20276		
Lot Number	-	-		
Date / Time Tested	27/08/2019 10:05	27/08/2019 10:15		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 12	Lot 11		
Easting	525294.999	525293.946		
Northing	6925479.603	6925469.052		
Level	RL 26.914	RL 27.618		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	5	6		
Compaction Sample Number	13385/S/93126	13385/S/93127		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	9.5	13.3		
Adjusted / Moisture Variation (%)	2.0	0.0		
Optimum Moisture Content (%)	11.5	13.5		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	82.0	99.5		
Density Test Results:				
Field Wet Density (t/m³)	2.12	2.09		
Adj/Peak Conv Wet Density (t/m³)	2.10	2.08		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	100.5	100.5		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34263-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19423
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20278
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	3/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/93373			
ID / Client ID	WR20278			
Lot Number	-			
Date / Time Tested	29/08/2019 08:50			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 46			
Easting	525339.811			
Northing	6925465.004			
Level	RL 26.978			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	11			
Compaction Sample Number	13385/S/93373			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	8.1			
Adjusted / Moisture Variation (%)	2.0			
Optimum Moisture Content (%)	10.5			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	77.0			
Density Test Results:				
Field Wet Density (t/m³)	2.26			
Adj/Peak Conv Wet Density (t/m³)	2.24			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	101.0			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34405-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19492
Component:	Bulk Earthwork Fill	Client Reference/s:	WR 20282
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	9/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/93751	13385/S/93752		
ID / Client ID	WR 20282	WR 20282		
Lot Number	-	-		
Date / Time Tested	5/09/2019 10:10	5/09/2019 12:00		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 45	Lot 44		
Easting	525334.637	525319.802		
Northing	6925453.000	6925453.809		
Level	RL 27.912	RL 28.349		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	15	15		
Compaction Sample Number	13385/S/93751	13385/S/93752		
Sample Description	GC Clayey GRAVEL, brown	GC Clayey GRAVEL, brown		
Moisture Test Results:				
Field Moisture Content (%)	9.3	6.5		
Adjusted / Moisture Variation (%)	3.5	2.5		
Optimum Moisture Content (%)	13.5	9.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	69.0	73.0		
Density Test Results:				
Field Wet Density (t/m³)	2.07	2.08		
Adj/Peak Conv Wet Density (t/m³)	2.08	2.11		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	99.5	99.0		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34406-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19462
Component:	Bulk Earthworks Fill	Client Reference/s:	WR 20280
Area Description:	Lot 4 Dalma St, Ormeau	Report Date / Page:	9/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/93582			
ID / Client ID	WR 20280			
Lot Number	-			
Date / Time Tested	3/09/2019 10:50			
Material Source	Site Won - Cut to Fill			
Material Type	Bulk Earthworks Fill			
Sampling Method	AS1289.1.2.1 CI 6.4b			
Depths: Test / Nom / Actual (mm)	175 / 200 / 200			
Standard or Modified	Standard			
Location	Lot 34			
Easting	525437.272			
Northing	6925471.769			
Level	RL 20.858			
Test Fraction (mm)	< 19.0 mm			
Sample Oversize (%)	20			
Compaction Sample Number	13385/S/93582			
Sample Description	GC Clayey GRAVEL, brown			
Moisture Test Results:				
Field Moisture Content (%)	6.4			
Adjusted / Moisture Variation (%)	2.0			
Optimum Moisture Content (%)	8.5			
Moisture Variation from OMC	(Drier than OMC)			
Moisture Ratio (%)	73.5			
Density Test Results:				
Field Wet Density (t/m³)	2.08			
Adj/Peak Conv Wet Density (t/m³)	2.11			
Density Ratio Required (%)	95			
Hilf Density Ratio (%)	99.0			

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34619-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19587
Component:	Bulk Earthworks	Client Reference/s:	WR 19434
Area Description:	Lot 4 Dalma Street	Report Date / Page:	17/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/94381	13385/S/94382		
ID / Client ID	-	-		
Lot Number	-	-		
Date / Time Tested	12/09/2019 14:05	12/09/2019 14:10		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 83	Lot 45		
Easting	525398.8	525333.6		
Northing	6925376.5	6925454.0		
Level	RL 25.6	RL 28.3		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	8	7		
Compaction Sample Number	13385/S/94381	13385/S/94382		
Sample Description	GC Clayey GRAVEL brown	GC Clayey GRAVEL brown		
Moisture Test Results:				
Field Moisture Content (%)	5.7	5.5		
Adjusted / Moisture Variation (%)	4.0	4.5		
Optimum Moisture Content (%)	10.0	10.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	57.5	54.5		
Density Test Results:				
Field Wet Density (t/m³)	2.27	2.17		
Adj/Peak Conv Wet Density (t/m³)	2.22	2.11		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	102.0	103.0		

Remarks



The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

Accreditation Number: 1986
Corporate Site Number: 13385



Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34842-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	-
Location:	Ormeau	Internal Test Request:	13385/T/19720
Component:	Bulk Earthworks	Client Reference/s:	WR: 20170
Area Description:	Lot 4 Dalma Street	Report Date / Page:	27/09/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/95257	13385/S/95258	13385/S/95259	
ID / Client ID	-	-	-	
Lot Number	-	-	-	
Date / Time Tested	24/09/2019 09:00	24/09/2019 09:20	24/09/2019 09:30	
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill	Site Won - Cut to Fill	
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill	Bulk Earthworks Fill	
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b	
Depths: Test / Nom / Actual (mm)	175 / 300 / 200	175 / 300 / 200	175 / 300 / 200	
Standard or Modified	Standard	Standard	Standard	
Location	Lot 24	Lot 22	Lot 21	
Easting	525398.98	525373.91	525344.02	
Northing	6925595.80	6925581.52	6925590.38	
Level	17.670	17.866	18.230	
Test Fraction (mm)	< 19.0 mm	< 19.0 mm	< 19.0 mm	
Sample Oversize (%)	9	12	0	
Compaction Sample Number	13385/S/95257	13385/S/95258	13385/S/95259	
Sample Description	GC Clayey GRAVEL, brown	clayey gravel brown	clayey gravel brown	
Moisture Test Results:				
Field Moisture Content (%)	7.4	6.3	7.6	
Adjusted / Moisture Variation (%)	2.5	4.5	4.5	
Optimum Moisture Content (%)	10.5	11.0	12.0	
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)	(Drier than OMC)	
Moisture Ratio (%)	72.0	58.0	62.5	
Density Test Results:				
Field Wet Density (t/m³)	2.16	2.01	2.11	
Adj/Peak Conv Wet Density (t/m³)	2.12	1.99	2.10	
Density Ratio Required (%)	95	95	95	
Hilf Density Ratio (%)	102.0	101.0	100.5	

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2

WET DENSITY RATIO REPORT

Client:	CCA Winslow	Report Number:	13385/R/34934-1
Client Address:	1587 Ipswich Road, ROCKLEA	Project Number:	13385/P/1078
Project:	Lot 4 Dalma Street	Lot Number:	N/A
Location:	Ormeau	Internal Test Request:	13385/T/19782
Component:	Bulk Earthworks Fill	Client Reference/s:	WR: 20235
Area Description:	Lot 4 Dalma Street	Report Date / Page:	2/10/2019 Page 1 of 1

Test Procedures:	AS1289.5.7.1, AS1289.5.8.1, AS1289.2.1.1
------------------	--

Sample Number	13385/S/95615	13385/S/95616		
ID / Client ID	-	-		
Lot Number	N/A	N/A		
Date / Time Tested	1/10/2019 08:30	1/10/2019 09:00		
Material Source	Site Won - Cut to Fill	Site Won - Cut to Fill		
Material Type	Bulk Earthworks Fill	Bulk Earthworks Fill		
Sampling Method	AS1289.1.2.1 CI 6.4b	AS1289.1.2.1 CI 6.4b		
Depths: Test / Nom / Actual (mm)	175 / 200 / 200	175 / 200 / 200		
Standard or Modified	Standard	Standard		
Location	Lot 32	Lot 24		
Easting	525386.96	5235387.44		
Northing	6925532.55	6925595.05		
Level	RL 22.96	RL 18.32		
Test Fraction (mm)	< 19.0 mm	< 19.0 mm		
Sample Oversize (%)	0	0		
Compaction Sample Number	13385/S/95615	13385/S/95616		
Sample Description	CL Sandy CLAY, brown	CL Sandy CLAY, brown		
Moisture Test Results:				
Field Moisture Content (%)	4.8	10.5		
Adjusted / Moisture Variation (%)	4.0	2.5		
Optimum Moisture Content (%)	9.0	13.0		
Moisture Variation from OMC	(Drier than OMC)	(Drier than OMC)		
Moisture Ratio (%)	54.0	82.0		
Density Test Results:				
Field Wet Density (t/m³)	2.17	2.15		
Adj/Peak Conv Wet Density (t/m³)	2.13	2.19		
Density Ratio Required (%)	95	95		
Hilf Density Ratio (%)	102.0	98.5		

Remarks


 The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.
Accredited for compliance with ISO/IEC 17025 - Testing

 Accreditation Number: 1986
Corporate Site Number: 13385



 Approved Signatory: Andrew Dickie
Form ID: W5ASRep Rev 2